

Preliminary Engineering Report Drainage Improvements

KAPAA HIGHLANDS – PHASE II

Prepared for:
Greg Allen
161 Wailua Rd.
Kapa'a, HI 96746

Prepared by:
Honua Engineering, Inc.
P. O. Box 851
Hanalei, HI 96714

Project Description

The Kapa'a Highlands Subdivision is on former cane lands situated on a bluff adjacent to the coastal plain of Kapa'a Town. It is bordered by Olohena Road to the north and the Kapa'a Bypass Road on the south and east sides of the project. Kapa'a Intermediate School is near the middle of the north portion of the property. Phase I of the development will consist of five agricultural lots on the west side of the property. The remainder of the property to the south and east of the school are proposed to be developed during Phase II of the subdivision. The proposed Phase II development will consist of 86 single and 683 multi-family units, plus a neighborhood commercial site, parks, and a church site as shown on Exhibit 1. Ground elevation of the development ranges from 20 to 180 feet above mean sea level.

Per the County of Kauai's "Storm Water Runoff System Manual" 2001, all developments of this scope are required to maintain the existing stormwater flows and patterns as feasibly possible so that downstream properties are not subject to any additional stormwater flows that are created by the increases in impervious surfaces of the watershed by the proposed development. The report examines the existing drainage conditions of the property and the proposed measures to control the stormwater from the proposed Phase II development.

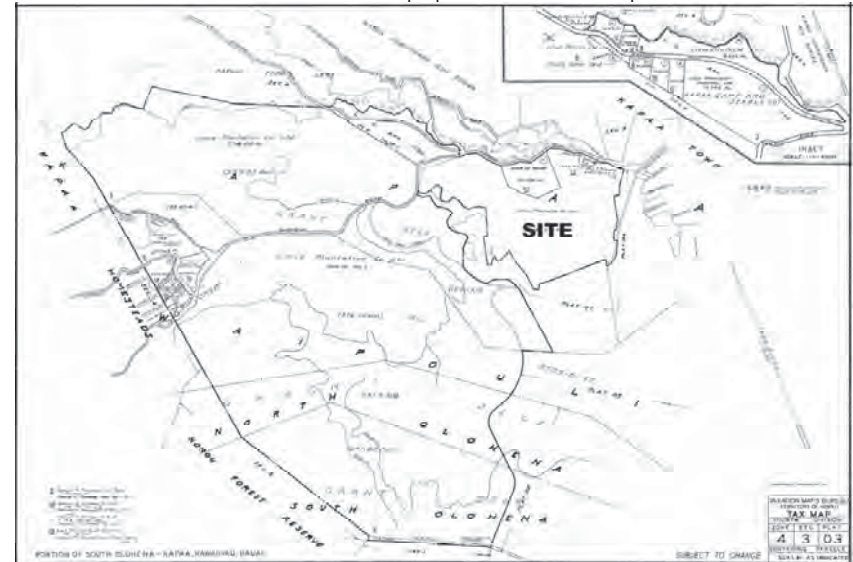


Figure 1: Tax Map Key 4-3-03 (4th Division)

Existing Conditions:

The property is located along Olohena Road about ½ mile mauka of Kapaa Town. The property rises from the coastal flat lands of Kapaa to an elevation of about 140 feet above mean sea level (msl). The Temporary Kapaa Bypass Road passes through a portion of the property along the east and south sides of the property. An unnamed stream flows along the west side of the property. The stream flows along the boundary, passes under a bridge on the By-Pass Road at the southwest corner of the property, and empties into the Waikaea drainage canal about 800' downstream from the property. Near the middle of the property on the north side, along Olohena Road, is the Kapaa Intermediate School site.

The Lihue Plantation had planted a majority of the 163-acre property in sugar cane, which since the property-changed owners has been allowed to go fallow. The Phase II portion of the property is approximately 97-acres. The fallow lands are presently overgrown with grass and remnant cane. A portion of the property on the northwest side near the unnamed stream is being used for cattle pasture. There are numerous abandoned irrigation ditches on the property that will be filled or rendered inoperable as the property is developed. There is also a small amount of the property that is overly steep for farming and is presently covered in brush and trees.

According to the Natural Resource Conservation Service (NRCS) soil survey the soils on the property are loleau and Puhi silt clay loams. The NRCS hydrologic classification for these soils is Group C for the loleau soils and Group B for the Puhi soils. Group B soils have a moderately low runoff potential, while the Group C soils have a moderately high runoff potential. Both soils are in Group I erosion resistance classification, which is the least erodible of the NRCS classifications.

The topography of the site varies from gently sloping, bluff top property, to steep areas that drop off into drainage gullies that lead to the unnamed stream and to the Bypass Road. The topography is illustrated on Exhibit 1 from aerial mapping done in 1975 for the County of Kauai.

Proposed Phase II:

The proposed Phase II development will consist of 86 single and 683 multi-family units, plus a neighborhood commercial site, parks, and a church site as shown on Exhibit 1. Stormwater generated from each of the Phase II lots will be directed to the nearest downstream street or natural drainageway. A drainage system along the streets will collect the stormwater and convey it to the detention basins shown on Exhibit 1. The detentions basins moderate the storm flows and allow infiltration back into the soil. They are sized so that the outlet peaks flows match or lower the existing stormwater flows prior to the development for both small rainfall events and the 100 year storm event.

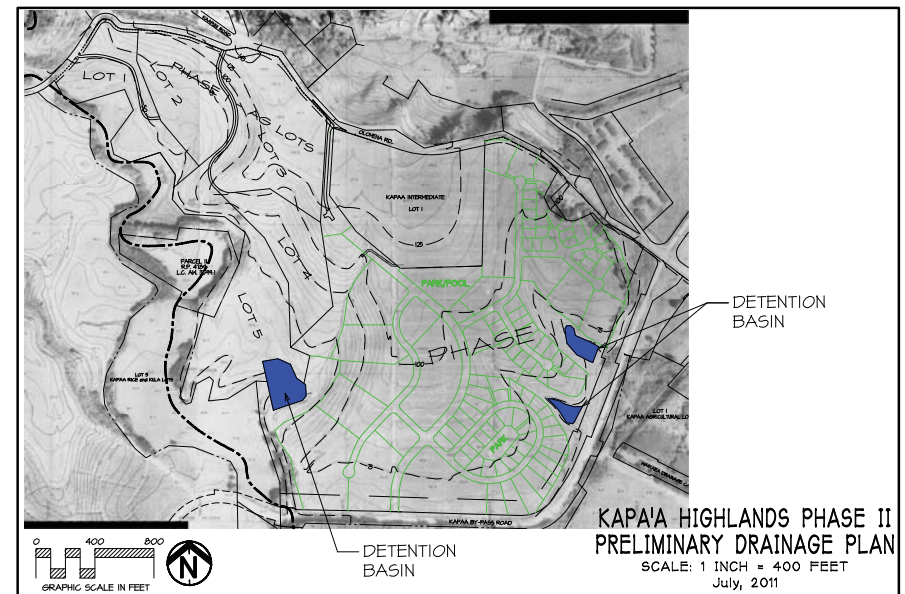


Exhibit G

**Preliminary Engineering Report Wastewater Improvements
Kapa'a Highlands Phase II**

**Preliminary Engineering Report
Wastewater Improvements**

KAPAA HIGHLANDS – PHASE II

Prepared for:
Greg Allen
161 Wailua Rd.
Kapa'a, HI 96746

Prepared by:
Honua Engineering, Inc.
P. O. Box 851
Hanalei, HI 96714

July 11, 2011
Project No: 1892

Project Description

The Kapa'a Highlands Subdivision is on former cane lands situated on a bluff adjacent to the coastal plain of Kapa'a Town. It is bordered by Olohena Road to the north and the Kapa'a Bypass Road on the south and east sides of the project. Kapa'a Intermediate School is near the middle of the north portion of the property. Phase I of the development will consist of five agricultural lots on the west side of the property. The remainder of the property to the south and east of the school are proposed to be developed during Phase II of the subdivision. The proposed Phase II development will consist of 86 single and 683 multi-family units, plus a neighborhood commercial site, parks, and a church site as shown on Exhibit 1. Ground elevation of the development ranges from 20 to 180 feet above mean sea level. Due to its high density the Phase II development will require connection to the Wailua-Kapa'a Sewer System. The following report reviews the anticipated wastewater flows, the adequacy of the existing sewer collection system, and the proposed improvements needed to provide service for the development of Phase II.

Basis of Design

The *Sewer Design Standards, 1973* by the County of Kauai, Department of Public Works, together with the *Wailua Facility Plan, September 2008* by Fukunaga and Associates were the primary references for this report and will be abbreviated as SDS and WFP, respectively, when quoted in the report.

The WFP is a detailed study of the entire Wailua to Kapa'a wastewater system completed in 2008 to guide the County with the necessary expansion and management of the system through the year 2025. It broke down projected flows to the Wailua Treatment Plant in three phases, the current and near term flows up to the year 2010, middle term flows for the 2010-2015 period, and far term flows for the years 2015 to 2025.

Wailua-Kapa'a Average Daily Wastewater Flows ¹	
Planning Interval	Average Wastewater Flow (mgd)
Current	0.70
Near Term (2010)	0.98
Middle Term (2015)	1.39
Far Term at Wailua WWTP(2025)	1.72
Kapaa Start-Up (2025)	0.40

The need for the WFP was partially based upon the rapid development that was occurring in the Wailua-Kapaa area during 2004-2007 period. Development has slowed

considerably since this time and several of the developments anticipated in the WFP calculations have been put on hold or are no longer proposed. Of the proposed developments, the Coco Palms Hotel will be removed from the near term anticipate flows and be considered part of the middle term flows. The Coconut Beach Resort and Coconut Plantation Village will be removed from the middle term flows and be considered for the far term flows.

The proposed Kapa'a Highlands development is not expected to be at total capacity by 2015, but for the purposes of this report, it will be considered to be completed in the middle term planning period of the WFP. The table below is the adjusted Average Daily Flows (ADF) based upon the current flow to the Wailua Treatment Plant and adjustments due to slower development than anticipated by WFP.

Adjusted Wailua-Kapa'a Average Daily Wastewater Flows	
Planning Interval	Average Wastewater Flow (mgd)
Current	0.70
Near Term (2010)	0.98
Middle Term (2015)	1.39
Far Term at Wailua WWTP(2025)	1.72

Kapa'a Highlands Phase II Wastewater Flow Estimates	
Item	Projected Wastewater Flow (gpd)
Single Family Homes	34,400
Multi-Family Homes	170,750
Neighborhood Commercial	4,800
Total	209,950

Note: Single Family Homes assumed to have 4 occupants/unit and Multi-Family Homes have 2.5 occupants/unit.

¹ Table ES-1, WFP, September 2008

Preliminary Design

Based upon the projected flow of 209,950 gpd (0.21 mgd), with a max load factor of 4.1, a 12" sewer main would be required to serve the development. The location of the main is shown on Exhibit 1. It would begin along the Kapa'a By-pass Road and terminate at an existing manhole near the intersection of Ulu and Kukui Streets. The length of the main within the existing public Right-of-Ways would be about 3,400 linear feet. At the existing manhole connection the existing main downstream of the connection is a 21" main with a capacity of 3.2 mgd. The 21" main currently has a peak flow of about 0.6 mgd, therefore the proposed flow is well within the capacity of the existing sewer system, including allowances for the future increases anticipated in the "Final Wailua Facility Plan", September 2008.

